

## Description

Distribution and trunk coaxial cable for burial installation - 75 Ohm

Underground installation cable (Screening Class A+)

Coaxial Cables

CAVEL®

since 1968

## Data Sheet

DG163



Ø	1,63	7,20	7,37	7,85		10,10
	(Cu)	(PEG)	(Al/Pet/Al/Sur)	(CuSn)	(Jelly2)	(PE)

## Class CPR acc. to UE 305/2011 (DoP)

F<sub>ca</sub>

The cable can be used in the field of application of the Construction Product Regulation (DoP) UE nr. 305/2011 for the class of performance specified on the related product label.

## Standards

EN 50117-2-3

## Fire-Resistance Rating

EN50575

## Construction data

Inner conductor of plain copper	(Cu)	Ø 1,63 ± 0,03	mm
Dielectric of physical foam polyethylene	(PEG)	Ø 7,20 ± 0,10	mm
Aluminium/Polyester/Aluminium/Surlyne tape longitudinally overlapped and bonded to the dielectric	(Al/Pet/Al/Sur)		
Braid of tinned copper wires	(CuSn)		
Braid optical coverage (IEC 96-1)		78	%
Braid optical coverage (IEC 96-1) - External		75	%
Tracer Identifier	Year + Flag		
Water repellent sealing (sheath)	(Jelly2)		
Diameter over Braid		Ø 7,85	mm
Outer sheath of Polyethylene - black - with carbonblack	(PE)	Ø 10,10 ± 0,15	mm
Printed each meter by yellow ink-jet :			

CAVEL DG 163 MADE IN ITALY 75 Ohm Euroclass Fca EN50117-2-3 CEI-UNEL 36762 C-4 (U0 = 400V)

ULTRA HD / 4K ggaan m

(ggg=day)(aa=year)(n=batch) (m=meter marking)

## Physical data

Weight of copper conductors	39,54	kg/km
Total weight of cable	91,74	kg/km
Minimum bending radius (single/repeated bending)	100	mm
Maximum cable pulling strength	300	N
Minimum installation temperature	-5	°C
Operating temperature	-40 / +80	°C

## Electrical data

Characteristic impedance	200 MHz	75 ± 2	Ohm
Capacitance (@1kHz)		52 ± 2	pF/m
Velocity Ratio		85 %	
Inner conductor resistance		8,50	Ohm/km

## ITALIANA CONDUTTORI s.r.l.

Viale Zanotti 90 I - 27027 Gropello Cairoli  
Tel +39-382.815150 Fax +39-0382.814212

## Date

12/05/2017

## Responsible

PierPaolo Piccinini

**Description**

Distribution and trunk coaxial cable for burial installation - 75 Ohm

Underground installation cable (Screening Class A+)



Data Sheet

**DG163**

Outer conductor resistance	7,50	Ohm/km
Loop resistance	16	Ohm/km
Sheat Insulation voltage (spark test)	8	kV
Maximum current (Ieff)	16	A

Structural return loss (SRL)	
5 - 470 MHz	>30 dB
470 - 1000 MHz	>28 dB
1000 - 2000 MHz	>23 dB
2000 - 3000 MHz	>20 dB

Screening Attenuation (SA)	SA-Class A+	Shield Transfer Impedance (Zt)	Zt-Class A
30 - 1000 MHz	>95 dB	5 - 30 MHz	< 4 mOhm/m
1000 - 2000 MHz	>95 dB		
2000 - 3000 MHz	>85 dB		


Attenuation (at 20°C )

Frequency [MHz]	Attenuation [dB/100m]	Frequency [MHz]	Attenuation [dB/100m]
5	1,10	862	12,30
10	1,50	1000	13,20
30	2,20	1750	17,90
50	2,80	2150	20,10
200	5,60	2400	21,60
300	6,90	3000	24,80
470	8,80		

**Attenuazione di schermatura / Screening Attenuation**

**Cavo classe A+ / A+ Class Cable**

Cavo tipo / Cable type: DG163

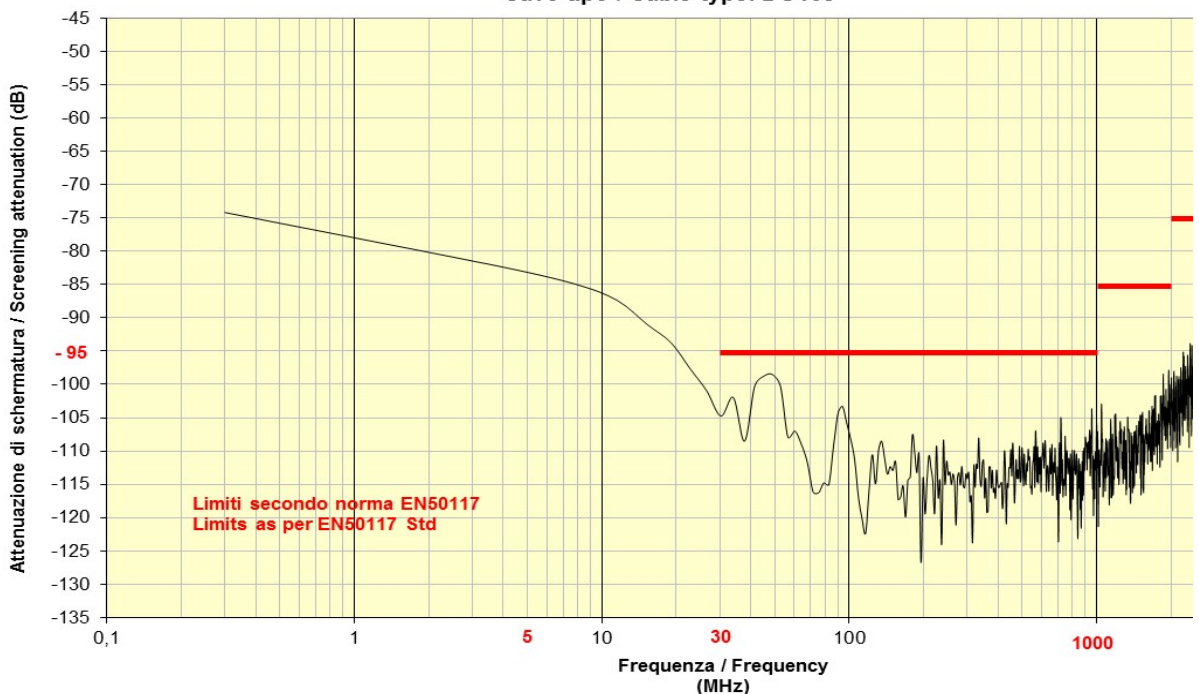

**ITALIANA CONDUTTORI s.r.l.**

Viale Zanotti 90 I - 27027 Gropello Cairoli  
Tel +39-382.815150 Fax +39-0382.814212

Date

12/05/2017

Responsible

PierPaolo Piccinini

**Description**

Distribution and trunk coaxial cable for burial installation - 75 Ohm

Underground installation cable (Screening Class A+)

**Data Sheet****DG163****Connectors**

<b>F163</b>	Series F Crimp, F Crimp, for INDOOR installation, nitin-plated brass - 35,0 mm x 14,0 mm
<b>FA17/73</b>	Series F Twist-On, F Twist-On, for INDOOR installation, nitin-plated brass - 33,0 mm x 14,5 mm
<b>FC11QM</b>	Series F Compression, Quick Mount, for OUTDOOR installation
<b>FM-TL232</b>	Series F, male, for UNDERGROUND (Hardline) installation, nitin-plated brass - 76,0 mm x 31,0 mm
<b>IEC14M-32</b>	Series IEC (toolless), male, for UNDERGROUND (Hardline) installation, nitin-plated brass - 64,5 mm x 21,0 mm
<b>NM-32</b>	N Connector, male, for UNDERGROUND (Hardline) installation, nitin-plated brass - 62,5 mm x 21,0 mm
<b>SR01-32</b>	Adapter, for 11/50 - RG11, for UNDERGROUND (Hardline) installation

**ITALIANA CONDUTTORI s.r.l.**Viale Zanotti 90 I - 27027 Gropello Cairoli  
Tel +39-382.815150 Fax +39-0382.814212

Date

12/05/2017

Responsible

PierPaolo Piccinini